

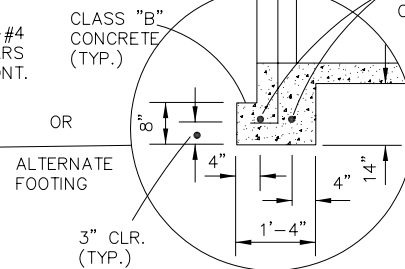
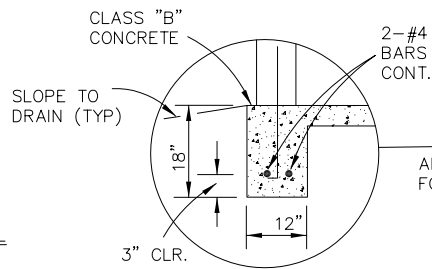
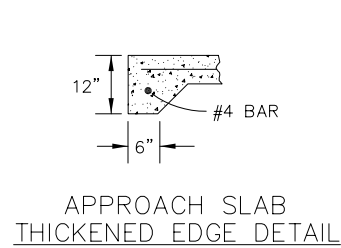


NOTE:  
1. 1/2" EXPANSION JOINT, ASTM D-1754  
PER MAG SECTION 729.

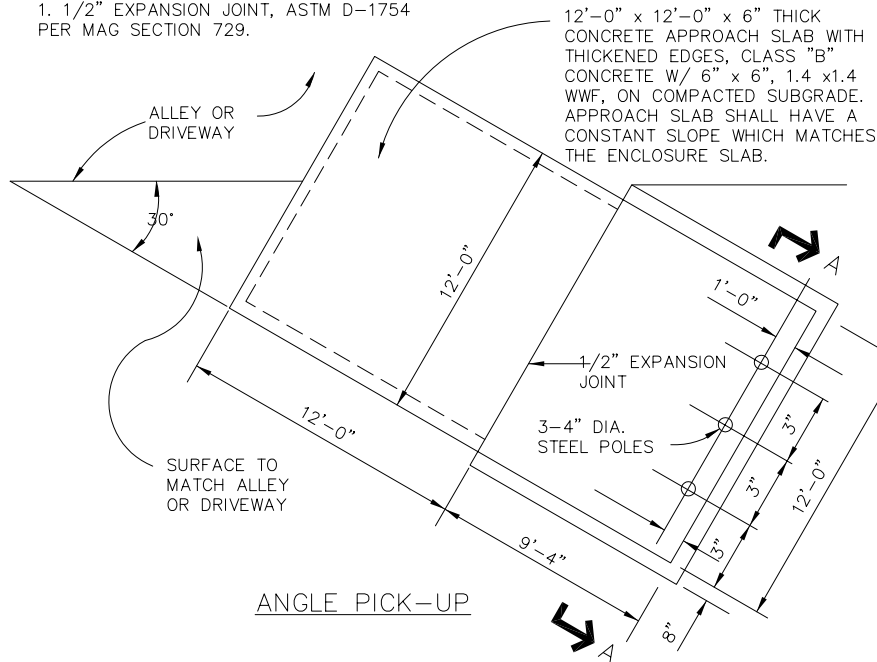


12'-0" x 12'-0" x 6" THICK CONCRETE APPROACH SLAB WITH THICKENED EDGES, CLASS "B" CONCRETE W/ 6" x 6", 1.4 x1.4 WWF, ON COMPACTED SUBGRADE. APPROACH SLAB SHALL HAVE A CONSTANT SLOPE WHICH MATCHES THE ENCLOSURE SLAB.

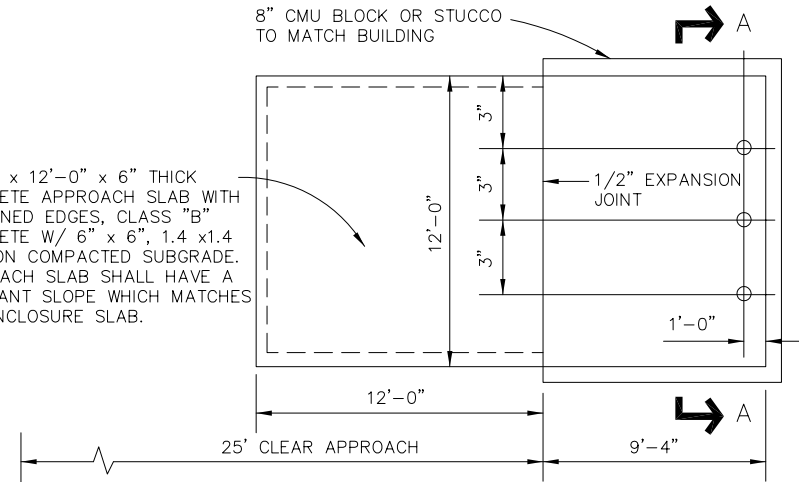

#### THICKENED EDGE DETAIL

PLACE 3-4" DIA. STEEL POLES 60" ABOVE GRADE. CAP OR GROUT FULL. PAINT TO MATCH WALL COLOR.

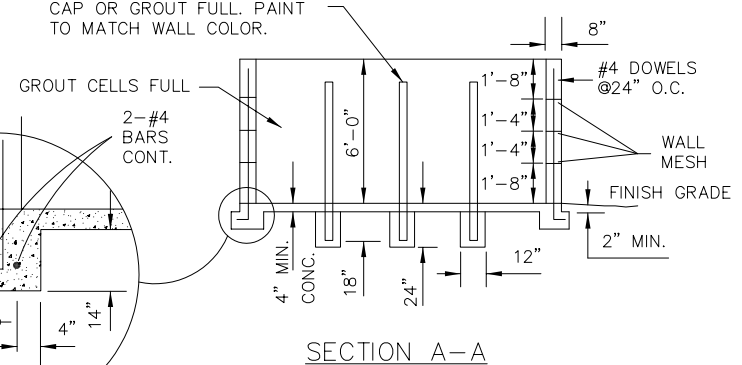


DETAIL NO.  
G-3162-1

CITY OF GOODYEAR  
STANDARD DETAIL

APPROVED BY:  
Goodyear Standards and  
Policies Committee 7/97

REFUSE ENCLOSURE


DETAIL NO.  
G-3162-1

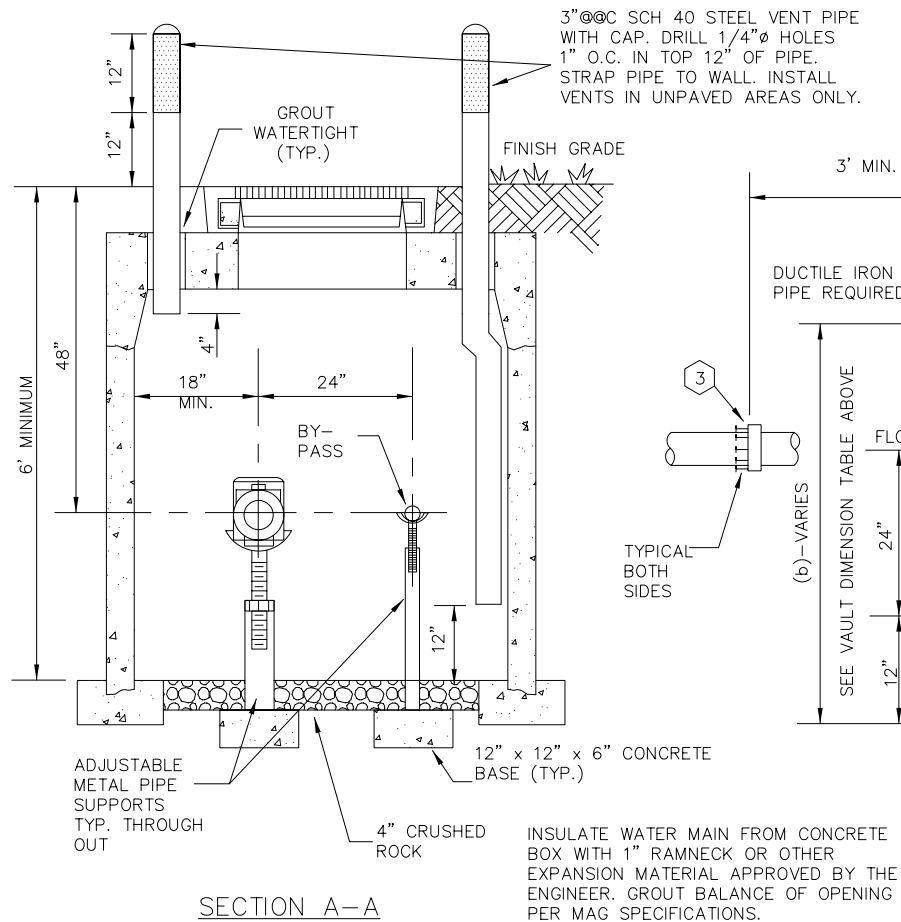

SECTION A-A

NOTE: METER VAULTS MAY BE EITHER BLOCK MASONRY OR CAST-IN-PLACE OR PRE-CAST CONCRETE, SEE MAG STD DETAIL 321 FOR VAULT CONSTRUCTION.

VAULT DIMENSIONS TABLE			
MAIN SIZE	3"	4"	6"
(A)	8'-4"	10'-6"	12'-0"
(B)	4'-6"	5'-0"	5'-0"

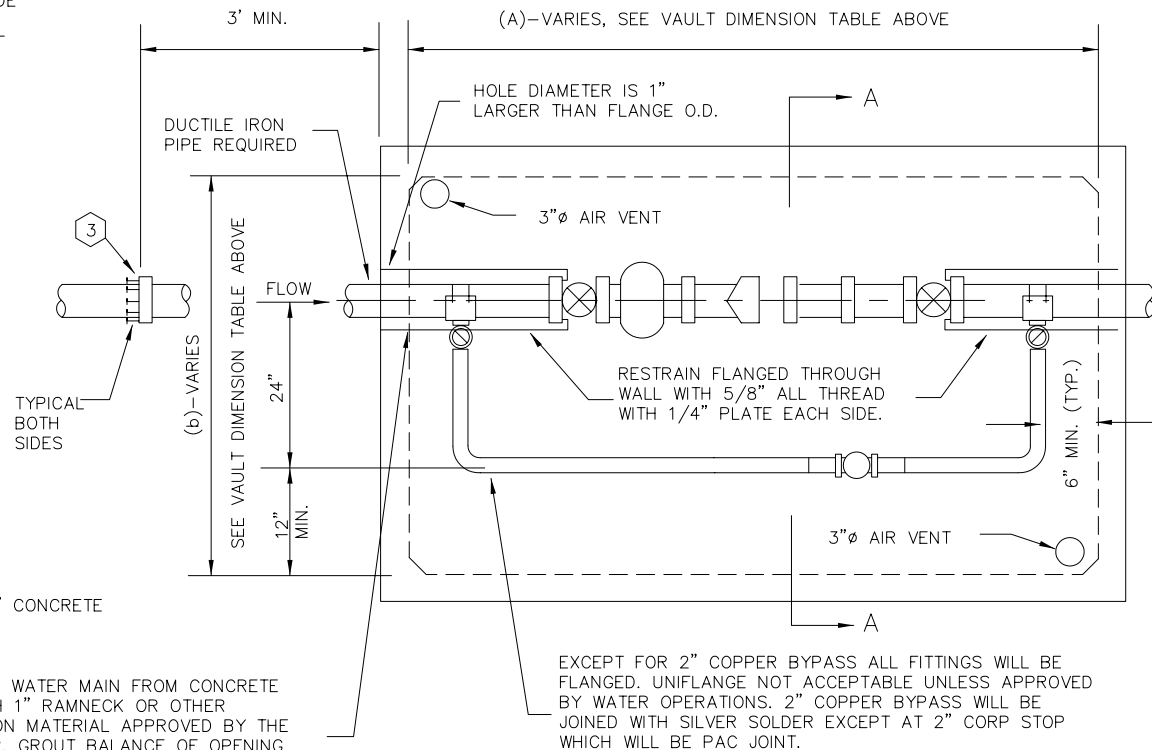

PLAN

# VAULT INSTALLATION

DETAIL NO.  
G-3162-2

CITY OF GOODYEAR  
STANDARD DETAIL

APPROVED BY:  
Goodyear Standards and  
Policies Committee 7/97

REFUSE ENCLOSURE  
W/ GREASE CONTAINMENT AREA

DETAIL NO.  
G-3162-2